



STANDARD DETAILS

CITY OF SHERWOOD
ARKANSAS


TITLE

DRIVEWAY DETAIL
FOR RESIDENTIAL DRIVEWAYS

STD-32

Issue Date
January, 2007

Revision Date

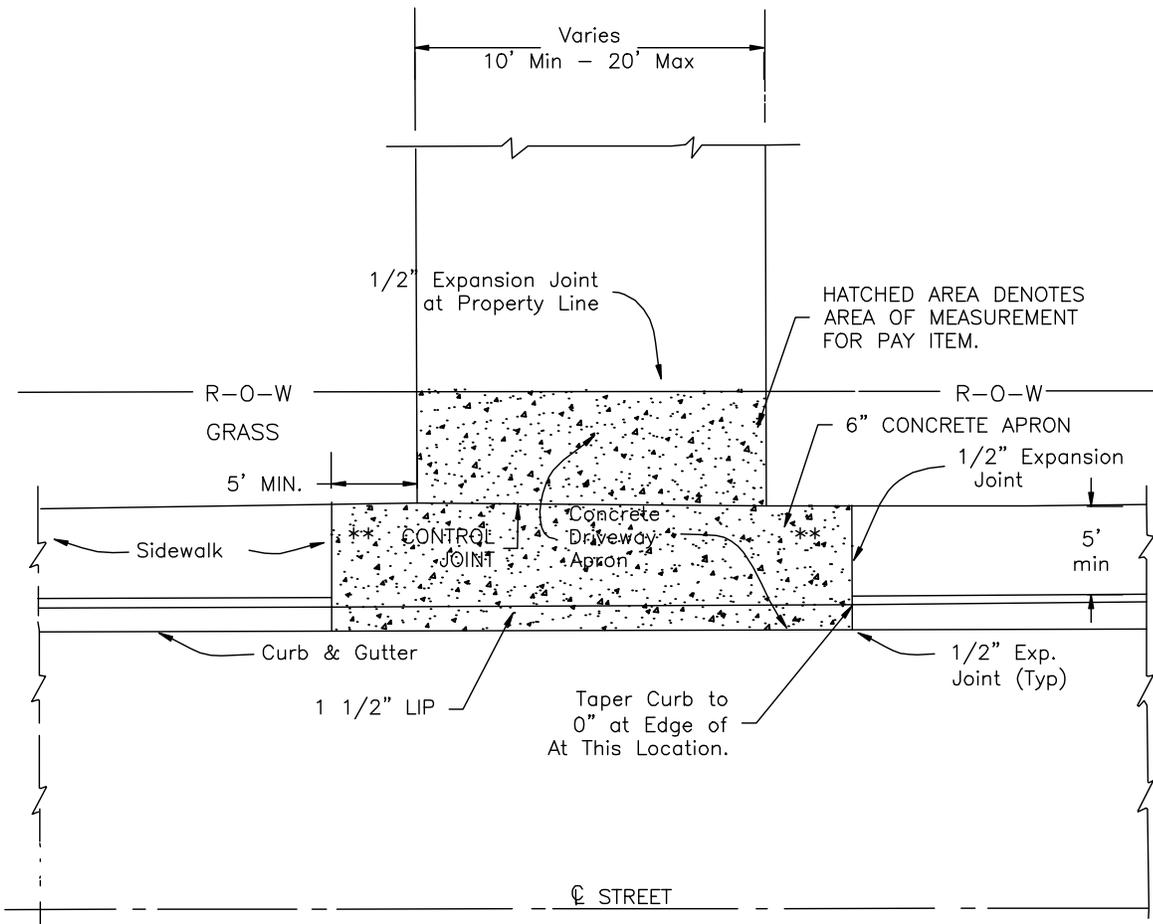

* Sidewalks at back of curb by permission of City of Sherwood Engineering Department (only when conditions dictate).

** Sidewalk area at driveway shall have cross slope of 1:50.

Thickness and reinforcements are required for conditions & expected wheel loading - 6" minimum thickness.

DRIVEWAY GRADES SHALL BE DESIGNED BY ENGINEER TO KEEP STORMWATER IN STREET, 2% MINIMUM SLOPE AT SIDEWALK CROSSING, MAXIMUM % OF GRADE CHANGE IS 16.