



STANDARD DETAILS

CITY OF SHERWOOD
ARKANSAS

TITLE


SIDEWALK ADJACENT TO
CURB
(AT-GRADE SECTION)

STD-42

Issue Date
January, 2007


Revision Date

GENERAL NOTE: PUBLIC SIDEWALK SHALL BE BUFFERED FROM STREET. SIDEWALK MAY BE INSTALLED ADJACENT TO CURB ONLY UPON RECEIVING WRITTEN AUTHORIZATION FROM CITY OF SHERWOOD ENGINEERING DEPARTMENT.

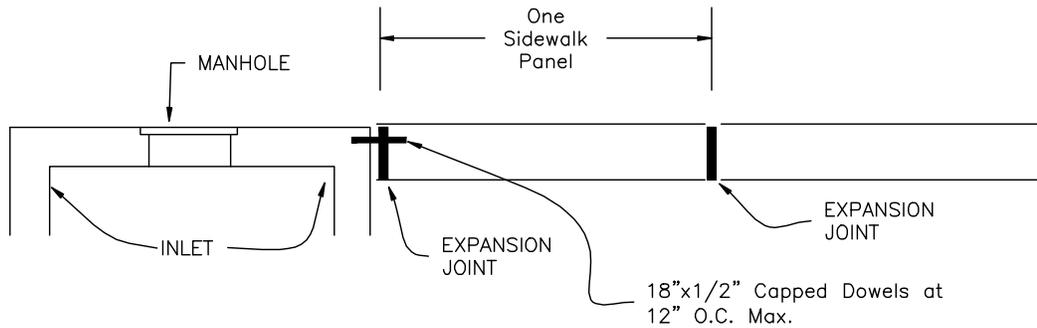

SIDEWALK AT INLETS

NOTE:
1/2" Expansion Joint Spacing at 60' Or adjacent to Structures and Drives.
Sidewalk Expansion Material is Required Between Sidewalk and Curb (requires prior approval for Adjacent to curb locations).
Dowel bars with Expansion Joint Material required at inlets.

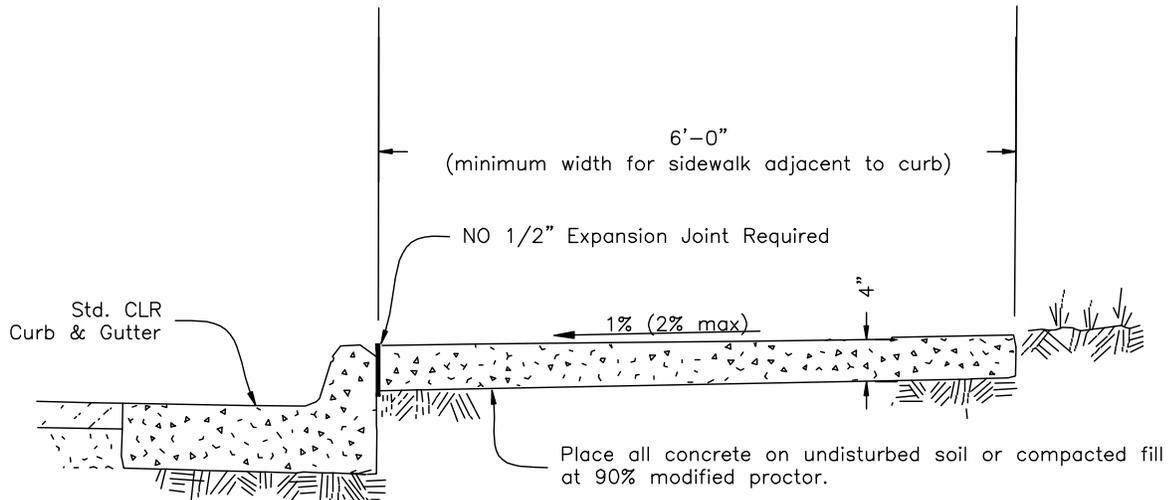

Expansion joint shall be installed between public sidewalks and private sidewalks, buildings or driveways.